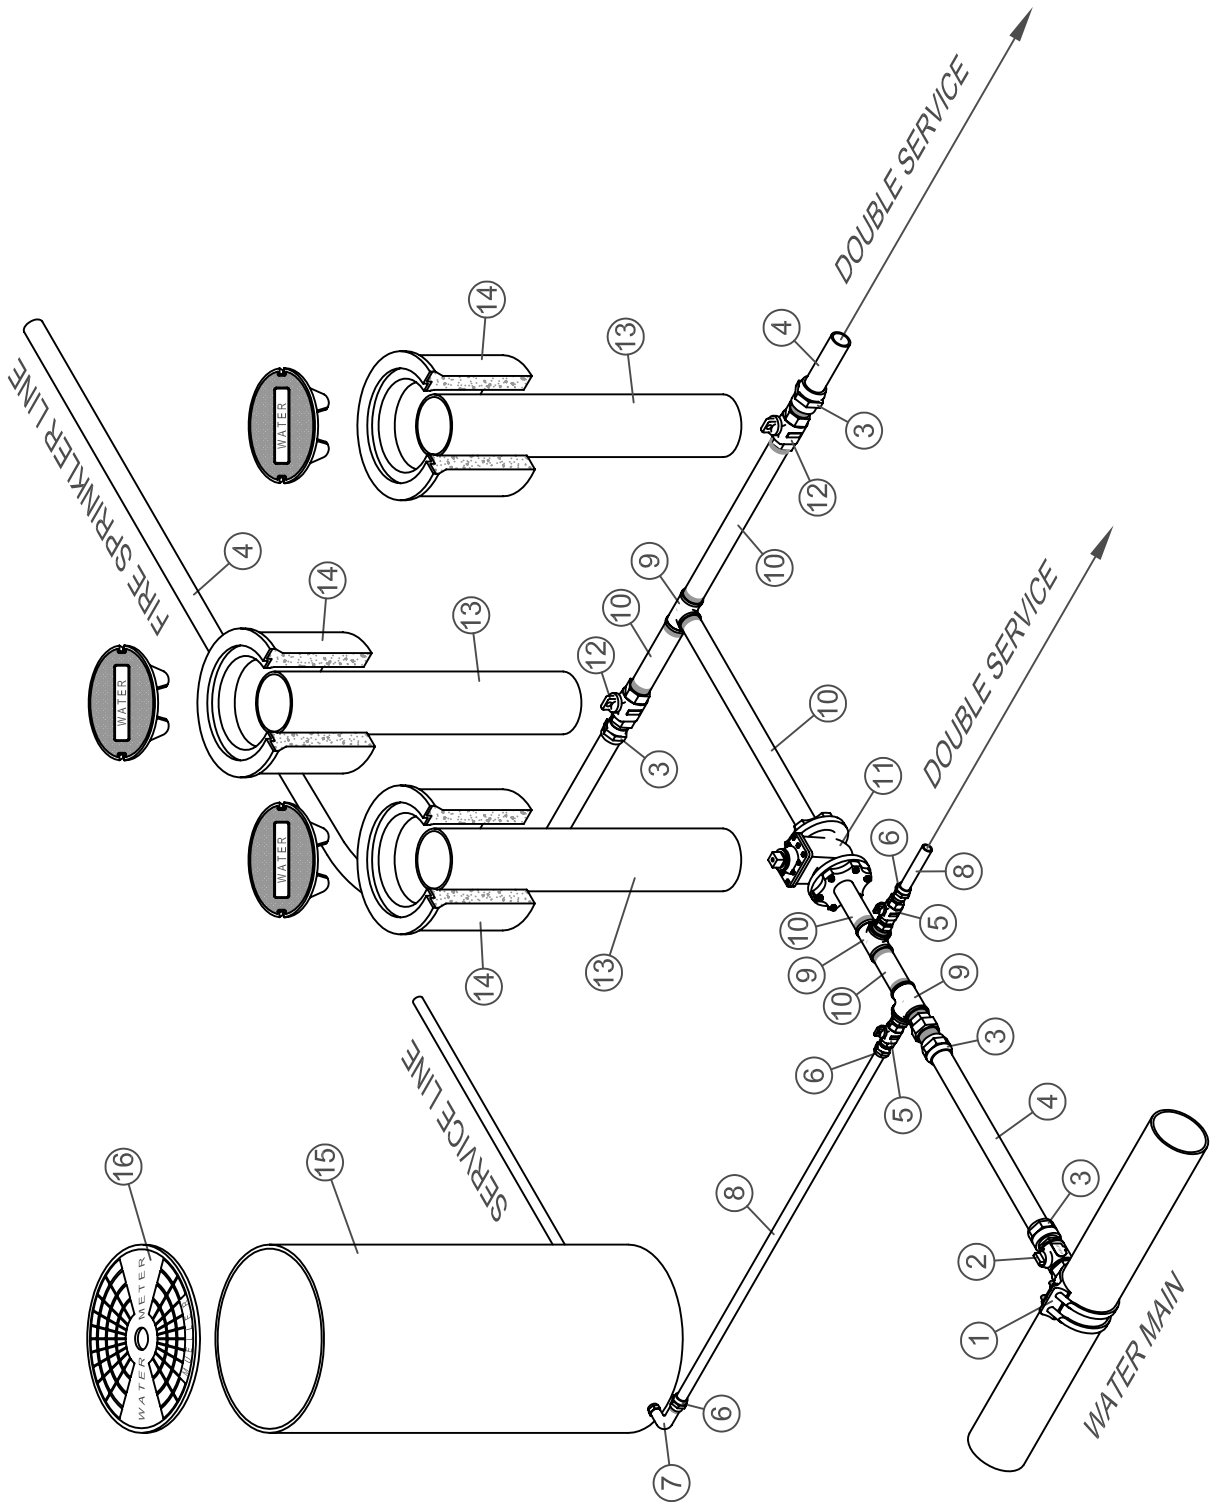

1. SERVICE SADDLE - DOUBLE STRAP
2. 2" CORPORATION STOP
3. 2" COMPRESSION FITTING
4. 2" PE PIPE OR COPPER PIPE (IPS)
5. 1" CURB BALL VALVE
6. 1" COMPRESSION FITTING
7. 1" STREET ELL
8. 1" PE PIPE OR TYPE "K" COPPER
9. 2" BRASS TEE
10. 2" BRASS NIPPLE
11. 2" RESILIENT WEDGE GATE VALVE
12. 2" CURB BALL VALVE
13. 8" PVC RISER WITH AN OSHA APPROVED LOCKING DEBRIS CAP
14. CHRISTY "G5" TRAFFIC VALVE BOX
15. MUELLER METER BOX WITH 1" METER AND 1" HARDWARE
16. 18"Ø FLAT LID - NO LOCK

N.C.S.D. UTILITIES	NORTHSTAR C.S.D.	DATE: APR. 2003	DIR.: WATER
	WATER SERVICE LINE DETAIL (ISOMETRIC VIEW)	DRAWN: JW	DWG. FILE: WO-1
		APPROVED: MS	FIGURE: 1
	908 NORTHSTAR DR. TRUCKEE, CA	SCALE: NONE	